



☎ : 7036071727

G. Pulla Reddy High School

(Affiliated to CBSE, Affiliation No.: 3630320)

ENGLISH MEDIUM CO-EDUCATION

Run by G. Pulla Reddy Charities Trust

MEHDIPATNAM, HYDERABAD - 28.

Ref.:

Date : 12/07/2023


UNDERTAKING

To whom it may concern


We the President of SMC & Secretary of Trust and Principal of G Pulla Reddy High School, Mehdipatnam, Hyderabad-500028, do hereby give an undertaking that reduction of sections from classes I to X shall be 34 sections out of approved 38 sections as per grant of affiliation issued by Central Board of secondary education Delhi vide letter no:CBSE/3630320/IS-90003-2324/2023-24/ dated: 26/10/2022

Class	No.of Sections	No.of Girls	No.of Boys	Total no.of Students
I	3	55	64	119
II	3	47	86	133
III	3	51	78	129
IV	3	56	69	125
V	4	66	99	165
VI	4	60	109	169
VII	3	47	73	120
VIII	4	65	86	151
IX	4	65	87	152
X	3	55	68	123

Signature of President / Trustee


President

Signature of Principal


Principal
G. Pulla Reddy High School
Mehdipatnam, Hyderabad-28.



ie Manager,
 PULLA REDDY HIGH SCHOOL MEHDIPATNAM HYD TL
 PULIA REDDY HIGH SCHOOL, H NO 12-2-822, MEHDIPATNAM
 ELANGANA, HYDERABAD, 500006
 (: 0-23515527)

SUBJECT: REGARDING REQUEST OF SCHOOL FOR ENHANCEMENT OF SECTIONS - REG.

/Madam,

This is with reference to school application No.-IS-90003-2324 dt. on the subject cited above.

In this connection, I am directed to convey approval of the Board to permit increase of sections in the school w.e.f t as per clause 4.8 of Affiliation Bye-Laws and subject to strict adherence to the other provisions of Affiliation and Examination Bye-Laws of the Board & appendix V of Affiliation Bye-Laws as well as the following specific conditions:

The approval is based upon the documents /data/information uploaded by the school online. The school will be responsible for its genuineness. In case of any discrepancies, necessary action will be initiated against the school as per Affiliation Bye -Laws-2018.

The school can open section and enroll student as per table given below

The school is required to renew Building Safety and Fire Safety certificates on regular basis.

The school will ensure adequate teaching staff and other physical facilities in the school for the smooth functioning with its enrolment.

The school will adhere to Rule 14.12 of Affiliation Bye laws of the Board and maintain optimum strength of 40 students in a section.

This approval will be subject to final outcome of any legal case/ litigation and any other issues arising out of shifting of school or otherwise and CBSE shall not be responsible for any dispute/legal issue arising out of increase in sections.

The Board reserves the right to conduct inspection of school as per clause 11.2 and 11.4 of Affiliation Bye Laws.

"The school shall possess valid fire safety certificate and Building safety certificate during functioning of the school which shall be renewed from time to time as per norms".

DEPUTY SECRETARY/JOINT SECRETARY (AF

ENROLMENT TABLE

Location of School	Campus area	Affiliation Allowed	Optimum No. of Sections (From classes I/VI to X/XII)
Areas/Cities mentioned in clause 3.6	1600 sqm	Up to Class-X only	10
Areas/Cities mentioned in clause 3.6	2400 sqm	Up to Class-XII	24
Areas/Cities mentioned in clause 3.6	3200 sqm	Up to Class-XII	28
Class-X Cities (Clauses 3.5) and Areas mentioned in clause 3.7	2000 sqm	Up to Class-X only	10
Class-X Cities (Clauses 3.5) and Areas mentioned in clause 3.7	3000 sqm	Up to Class-XII	24
Class-X Cities (Clause 3.5) and Areas mentioned in clause 3.7	4000 sqm	Up to Class-XII	28

Areas/Cities mentioned in clause 3.4			
Pan India (Clause 3.3)	6000 sqm	Up to Class-XII	38
Pan India (Clause 3.2)	8000 sqm	Up to Class-XII	48
Pan India (Clause 3.2)	>8000 sqm	Up to Class-XII	

The number of sections shall be restricted in accordance with 'H' above with land requirement unit scaled down to 2000 square meters i.e. 12 sections for every 2000 square meter additional land.

The total number of sections taken together for classes XI and XII should not be more than 1/3 of optimum number section allowed on the basis of land holding for any school.

The number of sections and students shall be restricted as per the actual facilities in the school.

For class rooms of size less than 500 sq feet the enrolment shall be 0.08 X size of class rooms in sq feet

P. Sangeeha
Principal
G. Pulla Reddy High School
Mehdipatnam, Hyderabad-28.

For G. PULLA REDDY HIGH SCHOOL
[Signature]
PRESIDENT.





G. Pulla Reddy High School

(Affiliated to CBSE, Affiliation No.: 3630320)

ENGLISH MEDIUM CO-EDUCATION

Run by G. Pulla Reddy Charities Trust

MEHDIPATNAM, HYDERABAD - 28.


Ref.:

Date : 12/07/2023

UNDERTAKING

To whom it may concern

We the President of SMC & Secretary of Trust and Principal of G Pulla Reddy High School, Mehdipatnam, Hyderabad -500028, do hereby give an undertaking that Building Safety certificate is issued by Telangana Government empanelled Architect Engineer and the same is countersigned by an Assistant Executive Engineer of PWD (Public Work Department Government of Telangana) . Copy of the same is enclosed herewith.

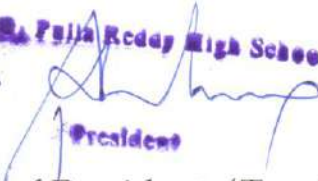G. Pulla Reddy High School,

 President

Signature of President / Trustee


 Principal
 G. Pulla Reddy High School
 Mehdipatnam, Hyderabad-28.

Signature of Principal





Date : 05-02-2019

BUILDING STRUCTURAL SOUNDNESS CERTIFICATE

This is Certify that the Building bearing No. 12-2-829/1 at Gudimalkapur, Mehdipatnam, Sy.Nos. 19,350,351,352,355&356 was designed and constructed for purpose of running Educational Institution. The Building is fit to use for 10Years for the School. Environmental is suitable for school.

1.Location : The Building is located with the following Boundaries:

- North : Main Road
- South : SBH Colony Road
- East : St. Anns College
- West : SBH Colony Road

2.Construction : The Building is Constructed for Ground+3Floors with the Total Built-up Area of 27,800Sft. The construction is done with RCC frame and brick walls. The specifications are as follows:

3.Specifications :Basement in C.R.S. (L.M.)

Brickwork in C.M.

Plastering (1:5) with C.M.

Columns, Beams, Roof, Sunshades & Lintels with RCC

Doors & Windows with Teak wood

Flooring with Shabad stones

Electrical, Sanitary & water supply as per standards

The quality of work and materials used are good. The building is under use and occupied by Educational Institution ie., "G. Pulla Reddy High School."

The Building is safe and fit for occupation for 10 years and can be used for school. We hereby certify Structural stability and safety of building.

P. Sangreetha
Principal

G. Pulla Reddy High School
Mehdipatnam, Hyderabad-28,

G. PULLA REDDY HIGH SCHOOL
[Signature]
PRESIDENT

[Signature]
ASST. EXECUTIVE ENGINEER
Divin. No. 10-A (CZ) G.H.M.C

[Signature]
Ch. V. Raghupathi

(Chief Consulting Engineer)

CH. V. RAGHUPATHI,
M.E. (Structures)

Structural Engineer
Lic. No. 21524 (CZ) G.H.M.C.



☎ : 7036071727

G. Pulla Reddy High School

(Affiliated to CBSE, Affiliation No.: 3630320)

ENGLISH MEDIUM CO-EDUCATION

Run by G. Pulla Reddy Charities Trust

MEHDIPATNAM, HYDERABAD - 28.


Ref.:

Date : 12/07/2023


UNDERTAKING

To whom it may concern

We the President of SMC & Secretary of Trust and Principal of G Pulla Reddy High School do hereby give an undertaking that within two months of time Building Safety certificate of second block of the school will be obtained from Assistant Executive Engineer PWD Hyderabad.

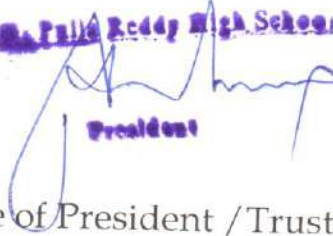G. Pulla Reddy High School

President

Signature of President /Trustee


Principal
G. Pulla Reddy High School
Mehdipatnam, Hyderabad-28.

Signature of Principal





☎ : 7036071727

G. Pulla Reddy High School

(Affiliated to CBSE, Affiliation No.: 3630320)

ENGLISH MEDIUM CO-EDUCATION

Run by G. Pulla Reddy Charities Trust

MEHDIPATNAM, HYDERABAD - 28.

Ref.:

Date : 12/07/2023

UNDERTAKING

To whom it may concern

We the President of SMC & Secretary of Trust and Principal of G Pulla Reddy High School, Mehdipatnam, Hyderabad-500028, do hereby give an undertaking that we will make Toilets for students of CWSN in remaining 3rd and 4th floors within three months from the date of issue of this letter.

G. Pulla Reddy High School.

President.

Signature of President / Trustee

P. Sangeetha
Principal

G. Pulla Reddy High School
Mehdipatnam, Hyderabad-28.

Signature of Principal





G. Pulla Reddy High School

(Affiliated to CBSE, Affiliation No.: 3630320)

ENGLISH MEDIUM CO-EDUCATION

Run by G. Pulla Reddy Charities Trust

MEHDIPATNAM, HYDERABAD - 28.

Ref.:

Date : 12/07/2023

UNDERTAKING

To whom it may concern

We the President of SMC & Secretary of Trust and Principal of G Pulla Reddy High School Hyderabad do hereby give an undertaking that school has ten thousand square feet (10000 sq.ft.) that is equal to 929 square metres of play ground within school campus for students and we also undertake that area of land correction shall be incorporated in a OASIS before 31st of July 2023.

G. Pulla Reddy High School,

President.

Signature of President /Trustee

P. Sangeeha
Principal

*G. Pulla Reddy High School
Mehdipatnam, Hyderabad-28.*

Signature of Principal





G. Pulla Reddy High School

(Affiliated to CBSE, Affiliation No.: 3630320)

ENGLISH MEDIUM CO-EDUCATION

Run by G. Pulla Reddy Charities Trust

MEHDIPATNAM, HYDERABAD - 28.

Ref.:

Date : 12/07/2023

UNDERTAKING

To Whom it may concern

We the President of SMC & Secretary of Trust and Principal of G Pulla Reddy High School, Mehdipatnam, Hyderabad-500028, do hereby give an undertaking that little portion of left over Boundary wall will be completed within three months from the date of issuing of this letter.

G. Pulla Reddy High School
President

Signature of President / Trustee

P. Sangaretha
Principal
G. Pulla Reddy High School
Mehdipatnam, Hyderabad-28.

Signature of Principal





☎ : 7036071727

G. Pulla Reddy High School

(Affiliated to CBSE, Affiliation No.: 3630320)

ENGLISH MEDIUM CO-EDUCATION

Run by G. Pulla Reddy Charities Trust

MEHDIPATNAM, HYDERABAD - 28.

Ref.:


Date : 12/07/2023


UNDERTAKING

To Whom it may concern

We the President of SMC & Secretary of Trust and Principal of G Pulla Reddy High School, Mehdipatnam, Hyderabad-500028, do hereby give an undertaking that No Objection Certificate regarding Fire Safety certificate is exempted vide letter no :GO.NO:56 dated :26.07.2019.

Circular Enclosed

G. Pulla Reddy High School,

President
Signature of President / Trustee


Principal
G. Pulla Reddy High School
Mehdipatnam, Hyderabad-28.

Signature of Principal





G. Pulla Reddy High School

☎ : 7036071727

(Affiliated to CBSE, Affiliation No.: 3630320)

Run by G. Pulla Reddy Charities Trust
MEHDIPATNAM, HYDERABAD - 28.

Ref.:

Date : 01-07-2023

To
The Director,
Ev & DM,
Fire Department,
Hyderabad.

Dear Sir/Madam

Sub:- Sec-Edn-Exemption of Fire N.O.C in r/o G.Pulla Reddy High School, Mehdiapatnam, Hyderabad- Submitted-req-regd.

Ref:- G.O.Ms.No.56. Dated 26-07-2019

With reference to the subject cited above. I am herewith submitting the Annexure I and II, under G.O.Ms, No.56 Dated 26-07-2019 for Exemption of fire N.O.C the management has been provided fire fighting material, underground and overhead water tank all pipe lines in G+3 floors in r/o G.Pulla Reddy High School, Mehdiapatnam, Hyderabad.



Yours Sincerely

P. Sanjeetha
Principal

G. Pulla Reddy High School
Mehdiapatnam, Hyderabad-28.

For G. PULLA REDDY HIGH SCHOOL

[Signature]
PRESIDENT

P. Sanjeetha
Principal
G. Pulla Reddy High School
Mehdiapatnam, Hyderabad-28.



SELF CERTIFICATION FORM

Self Certification of Fire Safety Measures by School Management:
 i) General Information for School Buildings of all categories i.e., A, B, C & D.


Sl. No.	Details	
1	Date of the opening of the school building	13-06-1985
2	Name of the applicant	G. Pulla Reddy High School
3	Name and address of the School	12-2-822 Mehli Patnam, Hyderabad
4	Telephone Number and email of the applicant	040-23575527 gpoHS School@gmail.com
5	Height of the building (in meters)	12 mlt
6	No of floors	03
7	Abutting Road width (in meters)	40 meters
8	Built-up area of each floor in Sq.Mtrs	~ SQ
	Stilt	197.90 mlt
	Ground	139.92 mts
	Floor1	835.90 mlt
	Floor2	263.26 mlt
9	Number of Staircases	
	Staircase 1	1.50 mlt (width in meters)
	Staircase 2	1.20 mlt (width in meters)
10	Width of each Staircase	1.50 mlt
11	Open Spaces	
	Front	S
	Side 1	i
	Side 2	g
	Rear	n
		t
		4856 mlt

Signature with date of School authority and Seal

A) School Buildings with Ground Floor or Ground plus one upper floor.

Sl. No	Fire equipment required	Scale of fire equipment as per Norms	Required	Provided
				Yes/ No
1	Fire Extinguishers (IS 2190:2010)	Two 09 liters water expelling extinguishers or ABC 4 kgs fire extinguisher, for every 200 square meters with minimum of 04 extinguishers per compartment/floor. The extinguisher should be so located as to be available within 15 meter radius.		Yes
2	Automatic Sprinkler System (IS 15105:2002). The IS standard may be downloaded from www.bis.gov.in/	To be installed in basement. If area of basement exceeds 200 square meters		Yes

Note: For Ground +1 floor buildings, if the floor area in a single floor is more than 500 square meters and if there is only single stair case, a second stair case of 1.5 Meters width shall be provided with concrete/Metal Steel structure.

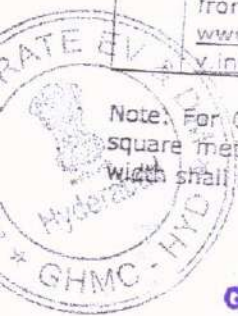

G. PULLA REDDY HIGH SCHOOL

[Signature]
PRESIDENT



[Signature]
P. Sangreetha
 Principal
 G. Pulla Reddy High School
 Mehli Patnam, Hyderabad-28.

B) School Buildings with Ground plus two floors and less than 15 Meters in height.

Sl. No	Fire equipment required	Scale of fire equipment as per Norms	Required	Provided
				Yes/No
1	Fire Extinguishers (IS 2190:2010)	Two 09 liters water expelling extinguishers or ABC 4 kgs fire extinguisher, for every 200 square meters with minimum of 04 extinguishers per compartment/floor. The extinguisher should be so located as to be available within 15 meter radius.		Yes
2	First Aid Hose Reel (IS 884:1985)	1 No for every 1000 square meter		Yes
3	Terrace Tank over respective tower terrace	10000 Liters (5000 Liters additionally shall be provided if basement exceeds 200 square meters)		Yes
4	Automatic Sprinkler System (IS 15105:2002) The IS standard may be downloaded from www.bis.gov.in/	To be installed in basement. If area of basement exceeds 200 square meters		- N A -
5	Pump capacity in LPM at the terrace tank level with minimum pressure of 3.5 kg/cm ²	450 LPM (450 LPM additionally shall be provided if basement exceeds 200 square meters)		Yes
Additional Fire Safety Measures in lieu of deficiency in Setbacks.				
1	Water Shower curtain	Water Shower curtain shall be provided in all floors on the side/sides having deficiency of setback to overcome exposure hazard from fires from neighboring property.		- N A -
2	Fire Brigade Inlet	02 Nos		

Note: If the floor area in a single floor more than 500 square meters and if there is only single stair case, a second stair case of 1.5 Meters width shall be provided with concrete/Metal steel structure.

P. Sangreetha
Principal
Signature with date of
School Authority and Seal
Mehdipatnam, Hyderabad-28.

C) School Buildings with 15 Meters and above but not exceeding 24 Meters in height

Sl. No	Fire equipment required	Scale of fire equipment as per Norms	Required	Provided
				Yes/No
1	Fire Extinguishers (IS 2190:2010)	Two 09 liters water expelling extinguishers or ABC 4 kgs fire extinguisher, for every 200 square meters with minimum of 04 extinguishers per compartment/floor. The extinguisher should be so located as to be available within 15 meter radius.		Yes



[Signature]
G. PULLA REDDY HIGH SCHOOL
PRESIDENT

P. Sangreetha
Principal
Scanned by G. Pulla Reddy High School
Mehdipatnam, Hyderabad-28.

2	
3	
4	Minimum open area for Fire hose lay Wash system IS: 24344 (2014) The Fire hose lay may be downloaded from www.bis.org.in/	...	Yes
5	Automatic Sprinkler System (IS: 15105:2 (2012) The IS standard may be downloaded from www.bis.org.in/	To be included in the contract if area of hazardous materials 200 square meters	No
6	Terrace Tank over respective lower terrace	20000 liters	Yes
7	Pump capacity in LPM at the terrace tank level with minimum pressure of 3.5 kg/cm ²	900 LPM	Yes

Additional Fire Safety Measures in lieu of deficiency in Setbacks

1	Water Shower curtain	To overcome exposure hazard to neighboring property water shower curtain covering entire side in all floors shall be provided on the side where there is deficiency in open space.	Yes
2	Water Monitors	04 Nos	Yes
3	Fire Brigade Inlet	Four way Fire brigade Inlet (02 Nos)	Yes
4	Wet Riser (IS: 3044:1994) (Note: it is required in the place of down comer)	1 No for every 1000 square meters	- NA -
5	Water supply : Underground static water storage tank with combined capacity for Wet riser, Yard hydrant and Sprinklers	50000 Liters additionally will be provided	Yes
6	Pump near underground static water storage tank (Fire Pump) with minimum pressure of 3.5 kg/cm ² at remotest location	Provide one Electric and one Diesel Pump (Standby) of capacity 2280 LPM and one electric pump of capacity 140 liter/ min. These will be additionally provided.	Yes
7	Risk Assessment by fire engineer	Risk assessment to be done by qualified fire engineer and any additional fire safety measures advised shall be provided.	Yes



G. PULLA REDDY HIGH SCHOOL
 - *[Signature]*
 - PRESIDENT

[Signature]
 School principal and
 G. Pulla Reddy High School
 MehdiPatnam, Hyderabad-28.

D) School Buildings above 24 Meters but not exceeding 30 Meters in height

Sl. No	Fire equipment required	Scale of fire equipment as per Norms	Required	Provided Yes/No
1	Fire Extinguishers (IS 2190:2015)	Two 4kg water expelling extinguishers or ABC 4 kgs fire extinguisher for every 200 square meters with minimum of 04 Extinguishers per compartment /floor. The extinguisher should be so located as to be available within 15 meter radius.		Yes
2	First Aid Hose Reel (IS 884:1983)	1 No for every 1000 square meters		- NA -
3	Wet Riser (IS: 3844:1984)	1 No for every 1000 square meters		- NA -
4	Yard Hydrant (IS 13039:1991)	1 No for every 30 meters distance on the ground level.		- NA -
5	Automatic Sprinkler System (IS 15105:2002) The IS standard may be downloaded from www.https://bis.gov.in/	To be installed in basement. If area of basement exceeds 200 square meters		- NA -
6	Manually Operated Electronic Fire Alarm Systems (IS 7240-11:2011). The IS standard may be downloaded from www.https://bis.gov.in/	To be provided at prominent places. Must be so mounted that they are visible along escape routes and be easily accessible.		Yes
7	Water supply : Underground static water storage tank with combined capacity for Wet riser, Yard hydrant and Sprinklers.	50000 Liters additionally will be provided.		Yes
8	Terrace Tank over respective tower terrace	25000 Liters (5000 Liters additionally shall be provided if basement area exceeds 200 square meters)		Yes
9	Pump near underground static water storage tank (Fire Pump with minimum pressure of 3.5 kg/cm ² at remotest location	Provide one Electric and one Diesel Pump (Standby) of capacity 2280 LPM and one electric pump of capacity 100 litre/ min. These will be additionally provided.		Yes
Additional Fire Safety Measures in lieu of deficiency in Setbacks				
1	Water Shower curtain	To overcome exposure hazard to neighboring property water shower curtain covering entire side in all floors shall be provided on the side where there is deficiency in open space.		Yes
2	Water Monitors	04 Nos		NA
	Fire Brigade Inlet	Four way Fire brigade inlet (02 Nos)		NA



G. Pulla Reddy High School
 President

G. Pulla Reddy High School
 Mehdipatnam, Hyderabad-28.
 Principal

4	Underground storage tanks shall have capacity of 1000 litres and hybrid fire extinguisher.		Yes
5	Fire Pump shall be provided static water storage tank (Fire Pump with minimum pressure of 3.5 kg/cm ² at remotest location (Note: up gradation of fire pumps capacity instead of Sl.No.9)	Fire pump shall be provided with capacity of 1000 litres. Fire Pumps shall consist of one Electric and one Diesel Pump (standby) of capacity 2000 LPM and one electric pump of capacity 150 litre/min. These will be additionally provided.	Yes
6	Risk Assessment by fire engineer	Risk assessment to be done by qualified fire engineer and any additional fire safety measures advised shall be provided.	Yes

Signature of _____

 G. Pulla Reddy High School
 Mehdipatnam, Hyderabad-28.

ii) General Fire Safety Measures which should be followed by all schools:-

Sl. No	General Fire Safety Measures	Whether followed Yes/No
1	The school building shall not be housed in temporary structures with roofs of tent cloth, thatched or any other combustible materials.	Yes
2	It should be ensured that the available Fire Safety Equipment is always in good working condition.	Yes
3	Pre-School, Kinder Garden and Class/Grade 1 Students shall be located on Ground Floor/level of Exit discharge and Class/Grade 2 Students shall be located not above One Floor higher than Ground Floor/level of Exit discharge	Yes
4	Kitchen should be constructed/provided away from the school building.	Yes
5	All Schools shall prepare an Evacuation Plan in consultation with local Fire Officer.	Yes
6	All Teachers/Employees should be trained in operating the available Fire Safety Equipment in the building.	Yes
7	All Exits/Escapes routes shall be kept free from any obstructions for free passage in case of any emergency.	Yes
8	All the internal staircases, lifts, lobbies and corridors should be adequately ventilated and illuminated.	Yes
9	If the school is provided with central Air-conditioning system, all safety measures as per Clause 10.1 of IS 14435:1997 should be followed.	Yes
10	School Buildings shall be kept free from inflammable and toxic material. If storage is inevitable, they should be stored safely.	Yes
11	Any Hazardous/Combustible Material/Volatile Flammable Liquids shall not be stored in School Buildings.	- NO -
12	DOs and DON'Ts in case of any Fire/Emergency shall be properly displayed at Strategic locations of the building.	Yes
13	Auto Glow Sign Boards shall be provided indicating Exits/Escapes Routes.	Yes
	Electric Wiring in the entire building shall be checked and certified by the competent authority.	Yes



G. Pulla Reddy High School,


 President

P. Sangeetha
 Principal
 G. Pulla Reddy High School
 Mehdipatnam, Hyderabad-28

5	Strategic location of the school building and its accessibility.	Yes
16	Water, Alarm, Fire, and other systems shall be in place for any emergency and fire systems shall cover the entire building.	Yes
17	Detailed information regarding the number of students in each Class Room and the number of teachers/staffs working shall be displayed at Strategic Locations of the building.	Yes
18	Display all Emergency supporting numbers such as nearest Fire Stations, Police Stations, Hospital/ Ambulance etc. on all floors and at Strategic locations.	Yes
19	A pictorial map with the details of Entries/Exits, details of Class Rooms/Laboratories/Staff Rooms and Open Place (Assembly Point) of the School Building shall be prepared and displayed in Strategic Locations.	Yes
20	If Basement area of the building exceeds 200 square meters, required to provide Automatic Sprinkler system as per IS 15105:2002	Yes

We.....School Management/Correspondent hereby certify that the information furnished is correct and if it is noticed at any time that the information provided is false, we understand that our school affiliation may be cancelled by the Concerned Authority. We have installed fire safety measures as per the Annexure I and undertake to maintain the same in good working condition at all times.

P. Bangaetha
 Signature with date of
 School Authority and Seal
 Mehdiapatnam, Hyderabad-28.

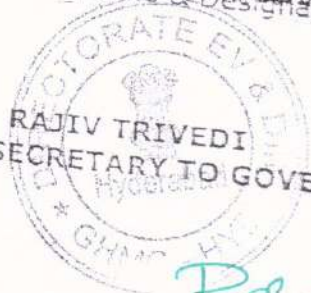

RAJIV TRIVEDI
 PRINCIPAL SECRETARY TO GOVERNMENT

P. Bangaetha
 Principal
 G. Pulla Reddy High School
 Mehdiapatnam, Hyderabad-28.

Copy to :
 The Divisional Fire Officer of concerned District.



G. Pulla Reddy High School
 President



G. Pulla Reddy High School

(Affiliated to CBSE, Affiliation No.: 3630320)

ENGLISH MEDIUM CO-EDUCATION

Run by G. Pulla Reddy Charities Trust

MEHDIPATNAM, HYDERABAD - 28.

Ref.:

Date : 01-07-2023

To
The Director,
Ev & DM,
Fire Department,
Hyderabad.

Dear Sir/Madam

Sub:- Sec-Edn-Exemption of Fire N.O.C in r/o G.Pulla Reddy High School, Mehdipatnam, Hyderabad- Submitted-req-regd.

Ref:- G.O.Ms.No.56. Dated 26-07-2019

With reference to the subject cited above. I am herewith submitting the Annexure I and II, under G.O.Ms, No.56 Dated 26-07-2019 for Exemption of fire N.O.C the management has been provided fire fighting material, underground and overhead water tank all pipe lines in G+3 floors in r/o G.Pulla Reddy High School, Mehdipatnam, Hyderabad.

Yours Sincerely

P. Sangeetha
Principal

G. Pulla Reddy High School
Mehdipatnam, Hyderabad-28.



ANNEXURE -I

(Annexure to G.O.Ms.No.56, Home (Ser.IV) Department, Dated: 26.07.2019)

Instructions to Be Followed For School Existing Before 13.04.2009;

SELF CERTIFICATION FORM

Self Certification Of Fire Safety Measures By School Management:

I) General Information for School Buildings of all Categories i.e., A, B, C, D.

Sl. No.	Details	
1.	Date Of The Opening Of The School Building	13-06-1985
2.	Name Of Applicant	G. Pulla Reddy High School
3.	Name And Address Of The School	12-2-822, Mehdiapatnam, Hyderabad
4.	Telephone Number And Email Of Applicant	040-2351527, gprh school@gmail.com
5.	Height Of The Building (In Meters)	12 Meters
6.	No Of Floors	03
7.	Abutting Road Width (In Meters)	40 meters
8.	Built Up Area Of Each Floor in Sq.Mtrs Stilt--199.90 m ² Ground 199.90 m ² Floor 1 285.90 m ² Floor 2 268.26 m ²	21367 m ²
9.	Number Of Stair Case Stair Case 1 -1.50 m ² (Width In Meters) Stair Case 2 -1.20 m ² (Width In Meters)	
10.	Width Of Each Stair Case	1.50 m ²
11.	Open Spaces Front----- (Width In Meters) Side 1----- (Width In Meters) Side 2----- (Width In Meters) Rear ----- (Width In Meters)	4856 m ²


D. Pruthi
Secretary Cum Correspondent
G. Pulla Reddy High School

P. Sangsetha
Headmistress
Signature with date of
School authority and seal
Mehdiapatnam, Hyd-28

A) School buildings with ground floor or ground plus one upper floor.

Sl. No	Fire equipment as per norms	Scale of fire equipment as per norms	Required	Provided
				Yes/No
1	Fire extinguishers (IS 2190:2010)	Two 09 liters water expelling extinguishers or ABC 4 kgs fire extinguishers ,for every 200 square meters with minimum of 04 extinguishers per compartment/floor. The extinguisher should be so located as to be available within 15 meters radius		Yes
2	Automatic sprinkler system(IS151505:2002), This IS standard may be downloaded from www.https://bis.gov.in/	To be installed in basement. If area exceeds 200 square maters		Yes

Note: For Ground +1 floor building, if the floor area in a single floor is more than 500 square meters and if there is only single stair case, a second stair case of 1.5 Meters width shall be provided with concrete/Metal Steel structure.

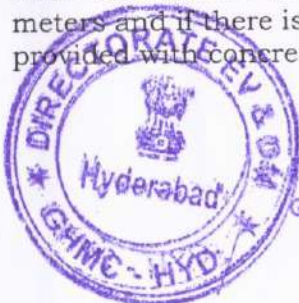

D. Pruthi
Secretary Cum Correspondent
G. Pulla Reddy High School
Mehdiapatnam, Hyd - 28

P. Sangsetha
Signature with date of
School Authority and seal
Mehdiapatnam, Hyd-28

Contd/-2

School Building with Ground plus two floors and less than 15Meters in height.

Sl. No	Fire equipment as per norms	Scale of fire equipment as per norms	Required	Provided
				Yes/No
1	Fire extinguishers (IS 2190:2010)	Two 09 liters water expelling extinguishers or ABC 4 kgs fire extinguishers ,for every 200 square meters with minimum of 04 extinguishers per compartment/floor. The extinguisher should be so located as to be available within 15 meters radius		Yes
2	First Aid Hose Reel (IS 884:1985)	1 No for every 1000 square meter		Yes
3	Terrace Tank over respective tower terrace	10000 Liters (5000 Liters additionally shall be provided if basement exceeds 200 square meters)		Yes
4	Automatic sprinkler system(IS 151505:2002), This IS standard may be downloaded from www.https://bis.gov.in/	To be installed in basement. If area exceeds 200 square maters		- NA -
5	Pump capacity in LPM at the terrace tank level with minimum pressure of 3.5 kg/cm ²	450 LPM (450 LPM additionally shall be provided if basement exceeds 200 square meters)		Yes

Additional Fire Safety Measures in lieu of deficiency in Setbacks.

1	Water Shower curtain	Water Shower curtain shall be provided in all floors on the side/sides having deficiency of setback to overcome exposure hazard from fires from neighboring property.		- NA -
2	Fire Brigade inlet	02 No.s		Yes

Note: If the floor area in a single floor more than 500 square meters and if there is only single stair case, a second stair case of 1.5,Meters width shall be provided with concrete/Metal steel structure.

D. Jeeva
Secretary Cum Correspondent
G, Pulla Reddy High School
Mehdipatnam, Hvd - 2nd

P. Sangarethra
Headmistress
Signature with date of
School authority and seal
Mehdipatnam, Hvd - 2nd

C) School Buildings with 15 Meters and above but not exceeding 24 Meters in height.

Sl. No	Fire equipment as per norms	Scale of fire equipment as per norms	Required	Provided
				Yes/No
1	Fire extinguishers (IS 2190:2010)	Two 09 liters water expelling extinguishers or ABC 4 kgs fire extinguishers ,for every 200 square meters with minimum of 04 extinguishers per compartment/floor. The extinguisher should be so located as to be available within 15 meters radius		Yes



2	First Aid Hose Reel (IS 884:1985)	1 No for every 1000 square meter		
3	Down comer (IS: 3844 : 1984)	1 No for every 1000 square meter		
4	Manually Operated Electronic Fire Alarm Systems(IS 7240-11-2011) The IS standard may be downloaded from www.https://bis.gov.in/	To be provided at prominent places. Must be so monitored that they are visible along escape routes and be easily accessible.		Yes
5	Automatic sprinkler system(IS151505:2002), This IS standard may be downloaded from www.https://bis.gov.in/	To be installed in basement. If area exceeds 200 square meters		- NO -
6	Terrace Tank over respective tower terrace	25000 Liters		Yes
7	Pump capacity in LPM at the terrace tank level with minimum pressure of 3.5 kg/cm ²	900 LPM		Yes

Additional Fire Safety Measures in lieu of deficiency in Setbacks.

1	Water Shower curtain	To overcome exposure hazard to neighboring property water shower curtain covering entire side in all floors shall be provided on the side where there is deficiency in open space.		Yes
2	Water Monitors	04 No.s		Yes
3	Fire Brigade inlet	Four way fire brigade Inlet (02 No.s)		Yes
4	Wet Riser (IS: 3844:1984) (Note: it is required in the place of down corner)	1 No for every 1000 square meters		- NA -
5	<u>Water supply:</u> Underground static water storage tank with combined capacity for Wet riser, Yard hydrant and Sprinklers	50000 Liters additionally will be provided.		Yes
6	Pump near underground static water storage tank (Fire Pump) with minimum pressure of 3.5 kg/cm ² at remotest location	Provide on Electric and one Diesel Pump (Standby) of capacity 2280 LPM and one electric pump of capacity 180 liter/min. These will be additionally provided.		Yes
7	Risk Assessment by fire engineer	Risk assessment to be done by qualified fire engineer and any additional fire safety measures advised shall be provided.		Yes



D. puethi
Secretary Cum Correspondent
G. Pulla Reddy High School
Mehdipatnam, Hyd - 28

P. Bangrethia
Signature with date of
School authority and seal
Mehdipatnam, Hyd-28

School Buildings with 15 Meters and above but not exceeding 30 Meters in height

Sl. No	Fire equipment as per norms	Scale of fire equipment as per norms	Required	Provided
				Yes/No
1	Fire extinguishers (IS 2190:2010)	Two 09 liters water expelling extinguishers or ABC 4 kgs fire extinguishers ,for every 200 square meters with minimum of 04 extinguishers per compartment/floor. The extinguisher should be so located as to be available within 15 meters radius		Yes
2	First Aid Hose Reel (IS 884:1985)	1 No for every 1000 square meter		- NA -
3	Wet Riser (IS: 3844:1984) (Note: it is required in the place of down corner)	1 No for every 1000 square meters		- NA -
4	Yard Hydrant (IS 13039: 1991)	1 No for every 30 meters distance on the ground level.		- NA -
5	Automatic sprinkler system(IS 151505:2002), This IS standard may be downloaded from www.https://bis.gov.in/	To be installed in basement. If area exceeds 200 square meters		- NA -
6	Manually Operated Electronic Fire Alarm Systems(IS 7240-11-2011) The IS standard may be downloaded from www.https://bis.gov.in/	To be provided at prominent places. Must be so monitored that they are visible along escape routes and be easily accessible.		Yes
7	<u>Water supply:</u> Underground static water storage tank with combined capacity for Wet riser, Yard hydrant and Sprinklers	50000 Liters additionally will be provided.		Yes
8	Terrace Tank over respective tower terrace	25000 Liters(5000 Liters additionally shall be provided if basement area exceeds 200 square meters)		Yes
9	Pump capacity in LPM at the terrace tank level with minimum pressure of 3.5 kg/cm ²	Provide one Electric and one Diesel Pump(Standby) of capacity 2280 LPM and one electric pump of capacity 180 litre/min. These will be additionally provided		Yes

Additional Fire Safety Measures in lieu of deficiency in Setbacks.

1	Water Shower curtain	To overcome exposure hazard to neighboring property water shower curtain covering entire side in all floors shall be provided on the side where there is deficiency in open space.		Yes
	Water Monitors	04 No.s		Yes
3	Fire Brigade Inlet	Four way fire brigade Inlet (02 No.s)		- NA -



4	<u>Water supply:</u> Underground static water storage tank with combined capacity for Wet riser, Yard hydrant and Sprinklers	50000 Liters additionally will be provided.	Yes
5	Pump near underground static water storage tank (Fire Pump) with minimum pressure of 3.5 kg/cm ² at remotest location(Note: up gradation of fire pumps capacity instead of Sl.No.9)	Provide on Electric and one Diesel Pump (Standby) of capacity 2280 LPM and one electric pump of capacity 180 liter/min. These will be additionally provided.	Yes
6	Risk Assessment by fire engineer	Risk assessment to be done by qualified fire engineer and any additional fire safety measures advised shall be provided.	Yes

D. Jeeva
Secretary Cum Correspondent
G. Pulla Reddy High School
Mehdipatnam, Hyd - 28

P. Bangarath
Signature with date of
G. Pulla Reddy High School
Mehdipatnam, Hyd-28

II) General Fire Safety Measures which should be followed by all schools:

Sl. No	General Fire Safety Measures	Whether followed Yes/No
1	The school building shall not be housed in temporary structures with roofs of tent cloth, thatched or any other combustible materials.	Yes
2	It should be ensured that the available Fire Safety Equipment is always in good working condition.	Yes
3	Pre-School, Kinder Garden and Class/Grade 1 students shall be located on Ground Floor/ level of Exit discharge and Class/Grade 2 students shall be located not above One Floor higher than Ground Floor/ Level of Exit discharge.	Yes
4	Kitchen should be constructed/provided away from the school building	NO
5	All schools shall prepare an Evacuation Plan in consultation with local Fire Officer	Yes
6	All Teachers/Employees should be trained in operating the available Fire Safety Equipment in the building.	Yes
7	All Exits/Escapes routes shall be kept free from any obstructions for free passage in case of any emergency.	Yes
8	All the internal staircases, lifts, lobbies and corridors should be adequately ventilated and illuminated.	Yes
9	If the school is provided with central Air-conditioning system, all safety measures as per Clause 10.1 of IS 14435:1997 should be followed.	Yes
10	School buildings shall be kept free from inflammable and toxic material. If storage is inevitable, they should be stored safely.	Yes
11	Any Hazardous/Combustible Material/Volatile Flammable Liquids shall not be stored in School Building	NO
12	Dos and DON'Ts in case of any Fire/Emergency shall be properly displayed at Strategic locations of the building.	Yes
13	Auto Glow Sign Boards shall be provided indicating Exits/Escapes Routes.	Yes
14	Electric Wiring in the entire building shall be checked and certified by the competent authority.	Yes



15	Structural Stability of the building shall be checked and certified by the competent authority	Yes
16	Public Address System shall be provided for use in case of any emergency and this system shall cover the entire building	Yes
17	Detailed information regarding the number of Students in each Class Room and the number of teachers/employees working shall be displayed at Strategic locations of the building.	Yes
18	Display all Emergency supporting numbers such as nearest Fire Stations, Police Stations, Hospitals/Ambulance etc., on all floors and Strategic locations.	Yes
19	A pictorial map with the details of Entries/Exits, details of Class Rooms/Laboratories/Staff Rooms and Open Place(Assembly Point) of the School Building shall be prepared and displayed in Strategic Locations.	Yes
20	If Basement area of the building exceeds 200 square meters, required to provide Automatic Sprinkler System as per IS 15105:2002	Yes

We, G. Pulla Reddy High School Management/Correspondent hereby certify that the information furnished is correct and if it is noticed at any time that the information provided is false, we understand that our school affiliation may be cancelled by the Concerned Authority. We have installed fire safety measures as per the Annexure I and undertake to maintain the same in good working condition at all times.



D. Pruthi
Secretary Cum Correspondent
G. Pulla Reddy High School
Mehdipatnam, Hyd 28

P. Sangeetha
Signature with date of ..
G. Pulla Reddy High School
Name & Designation:

Copy to:
The Divisional Fire Officer of concerned Dist